



**American Water Works
Association**

ANSI/AWWA C950-13
(Revision of AWWA C950-07)

The Authoritative Resource on Safe Water®

AWWA Standard



Fiberglass Pressure Pipe



Effective date: April 1, 2013.

First edition approved by AWWA Board of Directors Jan. 25, 1981.

This edition approved Jan. 20, 2013.

Approved by American National Standards Institute Jan. 30, 2013.

6666 West Quincy Avenue
Denver, CO 80235-3098
T 800.926.7337
www.awwa.org

*Advocacy
Communications
Conferences
Education and Training
Science and Technology
Sections*

AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or codes of any governmental authority. AWWA standards are intended to represent a consensus of the water supply industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed on the first page of the Official Notice section of *Journal - American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal - American Water Works Association* publication of the official notice.

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval date on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of ANSI approval. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; (212) 642-4900, or emailing info@ansi.org.

ISBN-13, print: 978-1-58321-916-4
ISBN-10, print: 1-58321-916-1

eISBN-13, electronic: 978-1-61300-213-1
eISBN-10, electronic: 1-61300-213-0

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2013 by American Water Works Association
Printed in USA

Committee Personnel

The AWWA Subcommittee on Revision of C950, which developed this revision, had the following personnel at the time:

Richard C. Turkopp, *Chair*

S.D. Curran, Fiberglass Tank & Pipe Institute, Houston, Texas	(AWWA)
L. Bowles, US Bureau of Reclamation, Denver, Colo.	(BUREC)
N.E. Kampbell, Rehabilitation Resource Solutions LLC, Hilliard, Ohio	(AWWA)
D.P. Kozman, American Water Services, Hilliard, Ohio	(AWWA)
A.M. May, Alfred M. May Consulting Services, Little Rock, Ark.	(SPI)
T.J. McGrath, Simpson Gumpertz & Heger Inc., Waltham, Mass.	(AWWA)
L.E. Pearson, Consultant, Vero Beach, Fla.	(SPI)
P.A. Sharff, Simpson Gumpertz & Heger Inc., Waltham, Mass.	(AWWA)
R.C. Turkopp, Hobas Pipe USA, Houston, Texas	(SPI)

The AWWA Standards Committee on Thermosetting Fiberglass Reinforced Plastic Pipe, which reviewed and approved this standard, had the following personnel at the time of approval:

Phillip A. Sharff, *Chair*

General Interest Members

S.J. Abrera Jr., South Pasadena, Calif.	(AWWA)
J.P. Biro, Houston, Texas	(AWWA)
D.M. Flancher,* Standards Engineer Liaison, AWWA, Denver, Colo.	(AWWA)
M.W. Grimm,* The Cadmus Group, Happy Valley, Ore.	(AWWA)
J.K. Jeyapalan, Dr. Jeyapalan & Associates, New Milford, Conn.	(AWWA)
R.A. Johnson, Russcor Engineering, Naples, Fla.	(AWWA)
N.E. Kampbell, Rehabilitation Resource Solutions LLC, Hilliard, Ohio	(AWWA)
T.J. McGrath,† Simpson Gumpertz & Heger Inc., Waltham, Mass.	(AWWA)
R.S. Morrison, Jason Consultants, Washington, D.C.	(AWWA)
L.E. Pearson, Vero Beach, Fla.	(AWWA)
P.A. Sharff, Simpson Gumpertz & Heger Inc., Waltham, Mass.	(AWWA)

* Liaison, nonvoting

† Alternate

Producer Members

S.D. Curran, Fiberglass Tank & Pipe Institute, Houston, Texas	(AWWA)
W. McCann, RF & H, Jacksonville, Fla.	(AWWA)
M.J. Warner, Ameron International, Phoenix, Ariz.	(AWWA)
R.C. Turkopp, Hobas Pipe USA, Houston, Texas	(SPI)
S.A. Khan,* Amiantit Fiberglass, Dammam, Saudi Arabia	(AWWA)
M. Turk,* Future Pipe Industries Inc., Houston, Texas	(AWWA)

User Members

P.A. Fragassi, Winthrop Harbor, Ill.	(AWWA)
L. Bowles, US Bureau of Reclamation, Denver, Colo.	(BUREC)

* Nonvoting member

Contents

All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.

SEC.	PAGE	SEC.	PAGE
Foreword		4.4	Materials 7
I	Introduction..... vii	4.5	Pipe Dimensions 7
I.A	Background..... vii	4.6	Pressure Classes 13
I.B	History..... vii	4.7	Stiffness Classes..... 14
I.C	Acceptance vii	4.8	Long-Term Ring-Bending Strain 14
II	Special Issues..... ix	4.9	Joint Types and Requirements 14
II.A	Nominal Metric Pipe Sizes, Dimensions, and Tolerances ix	5	Verification
III	Use of This Standard ix	5.1	Inspection and Testing 16
III.A	Purchaser Options and Alternatives ix	5.2	Rejection and Retesting..... 26
III.B	Manufacturer Options and Alternatives ix	6	Delivery
III.C	Modification to Standard x	6.1	Marking..... 27
IV	Major Revisions..... x	6.2	Shipping..... 27
V	Comments x	6.3	Affidavit of Compliance 27
Standard		Tables	
1	General	1	Dimensions for Inside Diameter Series Pipe..... 8
1.1	Scope 1	2	Metric Dimensions for Inside Diameter (ID) Series Pipe 9
1.2	Purpose 1	3	Dimensions for Outside Diameter (OD) Series Pipe With Steel-Pipe Equivalent (IPS) ODs 10
1.3	Application..... 2	4	Dimensions for Outside Diameter (OD) Series Pipe With Cast-Iron (Ductile-Iron)-Pipe Equivalent ODs 11
2	References 2	5	Metric Dimensions for Outside Diameter (OD) Series Pipe 12
3	Definitions 3		
4	Requirements		
4.1	Permeation 5		
4.2	Workmanship 6		
4.3	Cell Classification System..... 6		

6	Metric Dimensions for Outside Diameter (OD) Series Pipe With Ductile-Iron Pipe Equivalent ODs	13	10.B	Minimum Hoop Tensile Strength Requirements (from Eq 2) (N/mm of width).....	22
7	Hydrostatic Leak Test Pressure Requirements	17	11.A	Minimum Axial Strength Requirements (lbf /in. of circumference).....	23
8	Minimum Pipe Stiffness Requirements for 5 Percent Deflection.....	18	11.B	Minimum Axial Strength Requirements (N/mm of circumference).....	24
9	Ring Deflection Without Damage or Structural Failure	18	12	Beam Strength Requirements	25
10.A	Minimum Hoop Strength Requirements (from Eq 2) (lbf/in. of width).....	21	13	Minimum Axial Compressive Strength Requirements	26

Foreword

*This foreword is for information only and is not a part of ANSI*AWWA C950.*

I. Introduction.

I.A. *Background.* This standard provides direction and guidance in selecting and purchasing fiberglass pipe for use as pressure pipe in water distribution (including services) and transmission systems for both aboveground and belowground installations.

This standard describes 1-in. through 156-in. (25-mm through 4,000-mm) diameter pressure pipes. The primary materials used are thermosetting polyester or epoxy resins, glass-fiber reinforcement, and, if used, aggregate. There are nine pressure classes, which range from 50 psi through 450 psi (345 kPa through 3,103 kPa), in 50-psi (345-kPa) increments. Stiffness classes described are 9, 18, 36, and 72 psi (62, 124, 248, and 496 kPa). This standard may be used to the extent applicable for other sizes, pressure classes, and stiffness classes.

I.B. *History.* In June 1971, the AWWA Engineering and Construction Technical and Professional Committee organized the Reinforced Plastics Committee to evaluate both the use of reinforced plastics in the water-supply industry and the need for appropriate AWWA standards. The Reinforced Plastics Committee found sufficient use and interest to support a recommendation that a standard be developed for fiberglass pipe. The Standards Council authorized the formation of the Standards Committee on Thermosetting Fiberglass Reinforced Plastic Pipe in October 1972, and committee organization was completed in December 1974. The first edition of the standard was approved by the AWWA Board of Directors on Jan. 25, 1981. Subsequent editions were approved on June 23, 1988; Jan. 22, 1995; June 17, 2001; and Jan. 21, 2007. This edition was approved on Jan. 20, 2013

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the American Water Works Association Research Foundation (AwwaRF, now Water Research Foundation) and the Conference of State Health and Environmental Managers (COSHEM). The American Water Works Association and the Association of State Drinking Water Administrators (ASDWA) joined later.

* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.* Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state and local agencies may use various references, including

1. An advisory program formerly administered by USEPA, Office of Drinking Water, discontinued on Apr. 7, 1990.
2. Specific policies of the state or local agency.
3. Two standards developed under the direction of NSF, NSF[†]/ANSI[‡] 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.
4. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,[§] and other standards considered appropriate by the state or local agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 61. Individual states or local agencies have authority to accept or accredit certification organizations within their jurisdiction. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, “Toxicology Review and Evaluation Procedures,” to NSF/ANSI 61 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of “unregulated contaminants” are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA C950 does not address additives requirements. Thus, users of this standard should consult the appropriate state or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by all parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

* Persons outside the United States should contact the appropriate authority having jurisdiction.

† NSF International, 789 N. Dixboro Road, Ann Arbor, MI 48105.

‡ American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

§ Both publications available from National Academy of Sciences, 500 Fifth Street, N.W., Washington, DC 20001.

II. Special Issues.

II.A. *Nominal Metric Pipe Sizes, Dimensions, and Tolerances.* Nominal metric pipe sizes, dimensions, and tolerances were obtained from ISO and CEN product standards for fiberglass pipes.

III. Use of This Standard. It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

III.A. *Purchaser Options and Alternatives.* The following items should be covered by the purchaser:

1. Standard used—that is, ANSI/AWWA C950, Fiberglass Pressure Pipe, of latest revision.
2. Specific service and installation considerations.
3. Lineal feet of each pressure and stiffness class and size.
4. Details of other federal, state or provincial, and local requirements (Sec. 4.4.1).
5. Pipe diameter size and series (Sec. 4.5.1).
6. Pressure classes (Sec. 4.6).
7. Stiffness classes (Sec. 4.7).
8. Whether plant inspection is required (Sec. 5.1.1).

The purchaser may also specify the following:

1. Line layout showing pressure zones, including applicable design and transient pressures within zones and points of change between zones.
2. Cell classification (Sec. 4.3).
3. Standard laying lengths (Sec. 4.5.2).
4. Joint configuration (Sec. 4.9).

III.B. *Manufacturer Options and Alternatives.* The following items should be provided by the manufacturer:

1. Nominal wall thickness.
2. Weight.
3. Total quantity of jointing materials and field allowances.
4. Cell classification (Sec. 4.3).
5. Stiffness class (Sec. 4.7).
6. Joint details (Sec. 4.9).

When requested by the purchaser, it is understood the manufacturer will also supply the following:

1. Special design calculations.
2. Special lengths (Sec. 4.5.2).

3. Special preparations needed for shipment (Sec. 6.2).
4. Affidavit of compliance (Sec. 6.3).

III.C. *Modification to Standard.* Any modifications to the provisions, definitions, or terminology in this standard must be provided by the purchaser or manufacturer.

IV. Major Revisions. Major revisions made to the standard in this edition include the following:

1. Wording changes to clarify “production run” and materials permitted.
2. The mandatory hydrotesting diameter was increased from 54 in. to 96 in.
3. The hydrotesting pressure for diameters greater than 54 in. is 1.5× to better reflect current equipment capabilities available in the industry.

V. Comments. If you have any comments or questions about this standard, please call AWWA Engineering & Technical Services at 303.794.7711, FAX at 303.795.7603, write to the group at 6666 West Quincy Avenue, Denver, CO 80235-3098; or email standards@awwa.org.



**American Water Works
Association**

The Authoritative Resource on Safe Water®

AWWA Standard

Fiberglass Pressure Pipe

SECTION 1: GENERAL

Sec. 1.1 Scope

This standard describes the fabrication and the testing of nominal 1-in. through 156-in. (25-mm through 4,000-mm) fiberglass pipe and joining systems for use in both aboveground and belowground water systems. Service and distribution piping systems and transmission piping systems are included.

Both glass-fiber-reinforced thermosetting-resin pipe (RTRP) and glass-fiber-reinforced polymer-mortar pipe (RPMP) are fiberglass pipes. Epoxy-resin and polyester-resin systems are described, and commercial-grade glass-fiber is specified as the reinforcement material in the pipe wall. Liner materials incorporated include thermosetting or thermoplastic resin, reinforced or unreinforced, with or without fillers. Pressure classes described are 50, 100, 150, 200, 250, 300, 350, 400, and 450 psig (345, 689, 1,034, 1,379, 1,724, 2,069, 2,414, 2,759, and 3,103 kPa). Stiffness classes described are 9, 18, 36, and 72 psi (62, 124, 248, and 496 kPa). This standard may be used to the extent applicable for other diameters, pressure classes, and stiffness classes. For information on design, hydraulics, and installation, refer to AWWA Manual M45, *Fiberglass Pipe Design*.

Sec. 1.2 Purpose

The purpose of this standard is to provide the minimum requirements for fiberglass pressure pipe, including design, fabrication, and testing requirements.

Sec. 1.3 Application

This standard can be referenced in specifications for purchasing and receiving fiberglass pressure pipe. This standard can be used as a guide for manufacturing this type of fiberglass pressure pipe. The stipulations of this standard apply when this document has been referenced and then only to fiberglass pressure pipe.

SECTION 2: REFERENCES

This standard references the following documents. In their latest editions, these documents form a part of this standard to the extent specified within the standard. In case of conflict, the requirements of this standard shall prevail.

ASTM* D638—Standard Test Method for Tensile Properties of Plastics.

ASTM D695—Standard Test Method for Compressive Properties of Rigid Plastics. (historical standard)

ASTM D1599—Standard Test Method for Resistance to Short Time Hydraulic Pressure of Plastic Pipe, Tubing, and Fittings.

ASTM D2105—Standard Test Method for Longitudinal Tensile Properties of Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Tube.

ASTM D2290—Standard Test Method for Apparent Hoop Tensile Strength of Plastic or Reinforced Plastic Pipe by Split Disk Method.

ASTM D2412—Standard Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading.

ASTM D2992—Standard Practice for Obtaining Hydrostatic or Pressure Design Basis for Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Fittings.

ASTM D3517—Standard Specification for Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pressure Pipe.

ASTM D3567—Standard Practice for Determining Dimensions of Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Fittings.

ASTM D3681—Standard Test Method for Chemical Resistance of Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe in a Deflected Condition.

ASTM D4161—Standard Specification for Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe Joints Using Flexible Elastomeric Seals.

* ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428.

ASTM D5365—Standard Test Method for Long-Term Ring-Bending Strain of Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe.

ASTM F477—Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe.

AWWA Manual M45, *Fiberglass Pipe Design*.

SECTION 3: DEFINITIONS

The following definitions shall apply in this standard:

1. *Aggregate*: Siliceous sand with minimum 96 percent silicon (Si) compounds and maximum 2 percent passing No. 200 sieve.

2. *Centrifugal casting*: A process used to manufacture tubular goods by applying resin and reinforcement to the inside of a mold that is rotated and heated, subsequently polymerizing the resin system. The outside diameter (OD) of the finished pipe is determined by the inside diameter (ID) of the mold tube. The ID of the finished pipe is determined by the amount of material introduced into the mold. Other materials that will not adversely affect the laminate performance may be introduced in the process during manufacture of the pipe.

3. *Constructor*: The party that provides the work and materials for placement or installation.

4. *Epoxy resin (thermosetting)*: A polymer containing two or more three-membered rings, each consisting of one oxygen and two carbon atoms. The polymer is cured by cross-linking with an amine or anhydride hardener, with or without heat, catalyst, or both.

5. *Fiberglass pipe*: A tubular product containing glass-fiber reinforcements embedded in or surrounded by cured thermosetting resin. The composite structure may contain aggregate, granular or platelet fillers, thixotropic agents, and pigments or dyes. Thermoplastic or thermosetting liners or coatings may be included.

6. *Filament winding*: A process used to manufacture tubular goods by winding continuous glass-fiber roving or roving tape onto the outside of a mandrel or core pipe liner in a predetermined pattern under controlled tension. The roving may be saturated with liquid resin or preimpregnated with partially cured resin. Subsequent polymerization of the resin system may require application of heat. The ID of the finished pipe is fixed by the mandrel diameter or the inner diameter of the core pipe liner. The OD of the finished pipe is determined by the amount of material that is wound on the mandrel or core pipe liner. Other materials may

be introduced in the process during the manufacture of the pipe, which will not adversely affect the laminate performance.

7. *Fixed end:* The end of a pipe test specimen with an end closure configuration such that internal pressure produces only hoop and radial stresses in a straight pipe test specimen. Longitudinal thrust is absorbed by separate means, such as tie-rods, etc.

8. *Flexible joint:* A joint that is capable of axial displacement or angular rotation.

9. *Free end:* The end of a pipe test specimen with an end closure configuration such that internal pressure produces longitudinal stresses in addition to hoop and radial stresses in the pipe test specimen.

10. *Glass fabric:* A bidirectional fabric reinforcing material made by the weaving of glass-fiber yarn.

11. *Glass fibers:* A commercial grade of glass fibers compatible with the resin used.

12. *Joint restraint:* A separate external device or structure that is assembled or constructed around a joint to provide restraint to longitudinal tensile forces.

13. *Liner:* A filled or unfilled thermoplastic or thermosetting resin layer, nonreinforced or reinforced, that forms the interior surface of the pipe.

14. *Manufacturer:* The party that manufactures, fabricates, or produces materials or products.

15. *Mat:* A fibrous material consisting of random-oriented, chopped, or swirled filaments loosely held together with a binder.

16. *Polyester resin (thermosetting):* An ethylenic unsaturated polymer with two or more ester groups, dissolved in a reactive diluent with vinyl unsaturation. The polymer is cured by cross-linking using a free-radical-initiated curing mechanism, such as peroxide catalyst and heat.

17. *Purchaser:* The person, company, or organization that purchases materials or work to be performed.

18. *Purchaser's agent:* The authorized representative of the purchaser who is entrusted with the inspection of materials and production records and the observance of production operations and quality-control tests to ensure the products comply with the requirements of this standard and of the purchaser.

19. *Reinforced polymer-mortar pipe (RPMP):* A fiberglass pipe with aggregate.

20. *Reinforced thermosetting-resin pipe (RTRP):* A fiberglass pipe without aggregate.

21. *Resin*: Any of a class of solid or pseudosolid organic materials, often of high molecular weight, with no definite melting point. In the broad sense, the term is used to designate any polymer that is a basic material for plastics.

22. *Restrained joint*: Pipe joint capable of withstanding internal pressure and longitudinal tensile loads.

23. *Rigid joint*: A joint that is not capable of axial displacement or angular rotation.

24. *Roving*: A collection of parallel glass strands or filaments, coated with a finish or coupling agent to improve compatibility with resins, gathered without mechanical twist. Roving may be processed in a continuous or chopped form.

25. *Stiffness class*: The nominal stiffness of a specified pipe. (The stiffness class is determined as specified in Sec. 4.7.)

26. *Supplier*: The party that supplies materials or services. A supplier may or may not be the manufacturer.

27. *Surface layer*: A filled or unfilled resin layer, nonreinforced or reinforced, that is applied to the exterior surface of the pipe structural wall.

28. *Surfacing mat*: A thin mat of fine fibers used primarily to produce a smooth surface on a reinforced plastic.

29. *Tape*: A unidirectional glass-fiber reinforcement consisting of rovings knitted or woven into ribbon form.

30. *Thermoplastic resin*: A plastic that can be repeatedly softened by heating and hardened by cooling and that in the softened state can be fused or shaped by flow.

31. *Thermosetting resin*: A plastic that, after having been cured by heat or other means, is substantially infusible and insoluble.

32. *Unrestrained joint*: Pipe joint capable of withstanding internal pressure but not longitudinal tensile loads.

33. *Woven roving*: A glass-fiber fabric reinforcing material made by the weaving of glass-fiber roving.

SECTION 4: REQUIREMENTS

Sec. 4.1 Permeation

The selection of materials is critical for water service and distribution piping in locations where there is likelihood the pipe will be exposed to significant concentrations of pollutants composed of low-molecular-weight petroleum products or

organic solvents or their vapors. Documented research has shown that pipe materials (such as polyethylene and polyvinyl chloride) and elastomers, such as those used in jointing gaskets and packing glands, are subject to permeation by lower-molecular-weight organic solvents or petroleum products. If a water pipe must pass through such a contaminated area or an area subject to contamination, consult with the manufacturer regarding permeation of pipe walls, jointing materials, and so forth, *before* selecting materials for use in that area.

Sec. 4.2 Workmanship

The pipe shall be free from defects, including indentations, delaminations, bubbles, pinholes, cracks, pits, blisters, foreign inclusions, and resin-starved areas that, because of their nature, degree, or extent, detrimentally affect the strength and serviceability of the pipe. The pipe shall be as uniform as commercially practicable in color, opacity, density, and other physical properties.

Sec. 4.3 Cell Classification System

This standard describes products defined by a cell classification system and identifies the method of manufacture (type), construction and materials (grade), and liner construction (liner). The types, grades, and liners are identified in the following paragraphs. It should be noted that all possible combinations of types, grades, and liners may not be commercially available.

4.3.1 *Types.* The product type is determined by the method of manufacture, as follows:

Type I: Filament wound.

Type II: Centrifugally cast.

4.3.2 *Grades.* The product grade is determined by construction (glass-fiber-reinforced or glass-fiber-reinforced mortar) and materials (epoxy or polyester), as follows:

Grade 1: Glass-fiber-reinforced epoxy (RTRP epoxy).

Grade 2: Glass-fiber-reinforced polyester (RTRP polyester).

Grade 3: Glass-fiber-reinforced epoxy mortar (RPMP epoxy).

Grade 4: Glass-fiber-reinforced polyester mortar (RPMP polyester).

4.3.3 *Liners.* The product-liner classification is determined by whether or not a liner is used and, if used, whether it is a thermoplastic, reinforced, or nonreinforced thermoset. Classification of liners is as follows:

Liner A: No liner.

Liner B: Thermoplastic liner.

Liner C: Reinforced thermoset polyester liner.

Liner D: Nonreinforced thermoset polyester liner.

Liner E: Reinforced thermoset epoxy liner.

Liner F: Nonreinforced thermoset epoxy liner.

Sec. 4.4 Materials

The thermosetting resins, glass-fiber reinforcement, fillers, and other materials, when combined as a composite structure, shall produce piping products that meet the performance requirements of this standard as specified in Sec. 5.1.2.

4.4.1 *General.* Materials shall comply with the requirements of the Safe Drinking Water Act and other federal regulations for potable water, wastewater, and reclaimed water systems as applicable.

4.4.2 *Certification.* Fiberglass pipe intended for use in the transport of potable water shall be evaluated and certified for this use as required by the local authority.* The seal or mark of the laboratory that evaluates the pipe should be included on the fiberglass pipe.

4.4.3 *Gaskets and lubricants.* Gaskets and lubricants shall be made from materials that (1) are compatible with the plastic materials and with each other when used together; (2) will not support the growth of bacteria; and (3) will not adversely affect the potable qualities of water.

Sec. 4.5 Pipe Dimensions

4.5.1 *Diameters.* Pipe diameters and tolerances shall be as shown in Tables 1–6 when measured in accordance with ASTM D3567. These tables include dimensions for pipe based on both inside and outside diameters. In the latter case, tables are provided for steel-pipe equivalent ODs, cast-iron (ductile-iron)-pipe equivalent ODs, and metric ODs commonly used in international practice. As a group, the tables cover nominal pipe sizes 1 in. through 156 in. (25 mm through 4,000 mm); individual tables cover only a portion of the total range. Other dimensions for pipe are acceptable if agreed to between the purchaser and the manufacturer.

4.5.2 *Length.* Pipe shall be provided in standard laying lengths as agreed on by the purchaser and manufacturer. A maximum of 15 percent of the footage of each pipe size may be provided in random lengths. Each random length provided shall not vary by more than 25 percent from the standard laying length specified, except for special orders.

* See Sec. I.C, Acceptance, in the foreword for additional guidance.

Table 1 Dimensions for inside diameter series pipe

Nominal Pipe Size		Inside Diameter		Tolerance	
<i>in.</i>	<i>(mm)*</i>	<i>in.</i>	<i>(mm)</i>	<i>in.</i>	<i>(mm)</i>
1	(25)	1.00	(25.4)	±0.06	(±1.5)
1½	(40)	1.50	(38.1)	±0.06	(±1.5)
2	(50)	2.00	(50.8)	±0.06	(±1.5)
2½	(65)	2.50	(63.5)	±0.06	(±1.5)
3	(80)	3.00	(76.2)	±0.12	(±3.0)
4	(100)	4.00	(101.6)	±0.12	(±3.0)
6	(150)	6.00	(152.4)	±0.25	(±6.3)
8	(200)	8.00	(203.2)	±0.25	(±6.3)
10	(250)	10.00	(254.0)	±0.25	(±6.3)
12	(300)	12.00	(304.8)	±0.25	(±6.3)
14	(350)	14.00	(355.6)	±0.25	(±6.3)
15	(375)	15.00	(381.0)	±0.25	(±6.3)
16	(400)	16.00	(406.4)	±0.25	(±6.3)
18	(450)	18.00	(457.2)	±0.25	(±6.3)
20	(500)	20.00	(508.0)	±0.25	(±6.3)
21	(550)	21.00	(533.4)	±0.25	(±6.3)
24	(600)	24.00	(609.6)	±0.25	(±6.3)
27	(700)	27.00	(685.8)	±0.27	(±6.9)
30	(800)	30.00	(762.0)	±0.30	(±7.6)
33	(850)	33.00	(838.2)	±0.33	(±8.4)
36	(900)	36.00	(914.4)	±0.36	(±9.1)
39	(1,000)	39.00	(990.6)	±0.39	(±9.9)
42	(1,100)	42.00	(1,066.8)	±0.42	(±10.7)
45	(1,150)	45.00	(1,143.0)	±0.45	(±11.4)
48	(1,200)	48.00	(1,219.2)	±0.48	(±12.2)
51	(1,300)	51.00	(1,295.4)	±0.51	(±13.0)
54	(1,400)	54.00	(1,371.6)	±0.54	(±13.7)
60	(1,500)	60.00	(1,524.0)	±0.60	(±15.2)
66	(1,700)	66.00	(1,676.4)	±0.66	(±16.8)
72	(1,800)	72.00	(1,828.8)	±0.72	(±18.3)
78	(2,000)	78.00	(1,981.2)	±0.78	(±19.8)
84	(2,200)	84.00	(2,133.6)	±0.84	(±21.3)
90	(2,300)	90.00	(2,286.0)	±0.90	(±22.9)
96	(2,400)	96.00	(2,438.4)	±0.96	(±24.4)
102	(2,600)	102.00	(2,590.8)	±1.00	(±25.4)
108	(2,800)	108.00	(2,743.2)	±1.00	(±25.4)
114	(2,900)	114.00	(2,895.6)	±1.00	(±25.4)
120	(3,000)	120.00	(3,048.0)	±1.00	(±25.4)
132	(3,400)	132.00	(3,352.8)	±1.00	(±25.4)
144	(3,600)	144.00	(3,657.6)	±1.00	(±25.4)
156	(4,000)	156.00	(3,962.4)	±1.00	(±25.4)

*Closest customary metric equivalent.

Table 2 Metric dimensions for inside diameter (ID) series pipe

Nominal Pipe Size		Inside Diameter					
Metric Dimension*	Closest US Customary Unit Equivalent	Range <i>mm</i>		US Customary Unit Equivalent [†] <i>in.</i>		Tolerance	
<i>mm</i>	<i>in.</i>	<i>Minimum</i>	<i>Maximum</i>	<i>Minimum</i>	<i>Maximum</i>	<i>mm</i>	<i>(in.)</i>
25	1	23.5	26.5	0.93	1.04	±1.5	(±0.06)
40	1½	38	42.0	1.50	1.65	±1.5	(±0.06)
50	2	48	52.0	1.89	2.05	±1.5	(±0.06)
80	3	78	82.0	3.07	3.23	±1.5	(±0.06)
100	4	97	103	3.82	4.06	±1.5	(±0.06)
150	6	147	153	5.79	6.02	±1.5	(±0.06)
200	8	196	204	7.72	8.03	±1.5	(±0.06)
250	10	246	255	9.69	10.04	±1.5	(±0.06)
300	12	296	306	11.65	12.05	±1.8	(±0.07)
350	14	346	357	13.62	14.06	±2.1	(±0.08)
400	16	396	408	15.59	16.06	±2.4	(±0.09)
450	18	446	459	17.56	18.07	±2.7	(±0.11)
500	20	496	510	19.53	20.08	±3.0	(±0.12)
600	24	595	612	23.43	24.09	±3.6	(±0.14)
700	27	695	714	27.36	28.11	±4.2	(±0.17)
800	30	795	816	31.30	32.13	±4.2	(±0.17)
900	36	895	918	35.24	36.14	±4.2	(±0.17)
1,000	39	995	1,020	39.17	40.16	±4.2	(±0.17)
1,200	48	1,195	1,220	47.05	48.03	±5.0	(±0.20)
1,400	54	1,395	1,420	54.92	55.91	±5.0	(±0.20)
1,600	63	1,595	1,620	62.80	63.78	±5.0	(±0.20)
1,800	72	1,795	1,820	70.67	71.65	±5.0	(±0.20)
2,000	78	1,995	2,020	78.54	79.53	±5.0	(±0.20)
(2,200)	84	2,195	2,220	86.42	87.40	±5.0	(±0.20)
2,400	96	2,395	2,420	94.29	95.28	±6.0	(±0.24)
(2,600)	102	2,595	2,620	102.17	103.15	±6.0	(±0.24)
2,800	108	2,795	2,820	110.04	111.02	±6.0	(±0.24)
(3,000)	120	2,995	3,020	117.91	118.90	±6.0	(±0.24)
3,200	126	3,195	3,220	125.79	126.77	±6.0	(±0.24)
(3,400)	132	3,395	3,420	133.66	134.65	±7.0	(±0.28)
3,600	144	3,595	3,620	141.54	142.52	±7.0	(±0.28)
3,800	150	3,795	3,820	149.41	150.39	±7.0	(±0.28)
4,000	156	3,995	4,020	157.28	158.27	±7.0	(±0.28)

*Values taken from international practice; values in parentheses indicate nonpreferred diameters.

†US customary unit equivalent ID obtained by dividing millimeters by 25.4.

NOTE: The declared internal diameter of a pipe shall be between the minimum and maximum values given in columns 3 and 4. The average internal diameter at any point along the length of the pipe shall not deviate from the declared internal diameter by more than the permissible deviation given in column 7.

Table 3 Dimensions for outside diameter (OD) series pipe with steel-pipe equivalent (IPS) ODs

Nominal Pipe Size		Outside Diameter		Tolerance	
<i>in.</i>	<i>(mm)*</i>	<i>in.</i>	<i>(mm)</i>	<i>in.</i>	<i>(mm)</i>
1	(25)	1.315	(33.40)	+0.060	(+1.52)
				-0.016	(-0.41)
1½	(40)	1.900	(48.26)	+0.060	(+1.52)
				-0.018	(-0.46)
2	(50)	2.375	(60.33)	+0.060	(+1.52)
				-0.018	(-0.46)
2½	(65)	2.875	(73.03)	+0.060	(+1.52)
				-0.018	(-0.46)
3	(80)	3.500	(88.90)	+0.060	(+1.52)
				-0.018	(-0.46)
4	(100)	4.500	(144.30)	+0.060	(+1.52)
				-0.018	(-0.46)
6	(150)	6.625	(168.28)	+0.066	(+1.68)
				-0.028	(-0.71)
8	(200)	8.625	(219.08)	+0.086	(+2.18)
				-0.040	(-1.02)
10	(250)	10.750	(273.05)	+0.108	(+2.74)
				-0.048	(-1.22)
12	(300)	12.750	(323.85)	+0.128	(+3.25)
				-0.056	(-1.42)
14	(350)	14.000	(355.60)	+0.140	(+3.56)
				-0.062	(-1.57)
16	(400)	16.000	(406.40)	+0.160	(+4.06)
				-0.070	(-1.78)

* Closest customary metric equivalent.

NOTE: The external diameter of the pipe at the spigots shall be within the tolerances given in the table, and the manufacturer shall declare the allowable maximum and minimum spigot diameters. Some pipes are manufactured such that the entire pipe meets the OD tolerances, while other pipes meet the tolerances at the spigots—in which case, if such pipes are cut (shortened), the ends may need to be calibrated to meet the tolerances.

Table 4 Dimensions for outside diameter (OD) series pipe with cast-iron (ductile-iron)-pipe equivalent ODs

Nominal Pipe Size		Outside Diameter		Tolerance	
<i>in.</i>	<i>(mm)*</i>	<i>in.</i>	<i>(mm)</i>	<i>in.</i>	<i>(mm)</i>
2	(50)	2.50	(63.5)	+0.05	(+1.3)
				-0.05	(-1.3)
3	(80)	3.96	(100.6)	+0.06	(+1.5)
				-0.06	(-1.5)
4	(100)	4.80	(121.9)	+0.06	(+1.5)
				-0.06	(-1.5)
6	(150)	6.90	(175.3)	+0.06	(+1.5)
				-0.06	(-1.5)
8	(200)	9.05	(229.9)	+0.06	(+1.5)
				-0.06	(-1.5)
10	(250)	11.10	(281.9)	+0.06	(+1.5)
				-0.06	(-1.5)
12	(300)	13.20	(335.3)	+0.06	(+1.5)
				-0.06	(-1.5)
14	(350)	15.30	(388.6)	+0.05	(+1.3)
				-0.08	(-2.0)
16	(400)	17.40	(442.0)	+0.05	(+1.3)
				-0.08	(-2.0)
18	(450)	19.50	(495.3)	+0.05	(+1.3)
				-0.08	(-2.0)
20	(500)	21.60	(548.6)	+0.05	(+1.3)
				-0.08	(-2.0)
24	(600)	25.80	(655.3)	+0.05	(+1.3)
				-0.08	(-2.0)
30	(800)	32.00	(812.8)	+0.08	(+2.0)
				-0.06	(-1.5)
36	(900)	38.30	(972.8)	+0.08	(+2.0)
				-0.06	(-1.5)
42	(1,100)	44.50	(1,130.3)	+0.08	(+2.0)
				-0.06	(-1.5)
48	(1,200)	50.80	(1,290.3)	+0.08	(+2.0)
				-0.06	(-1.5)
54	(1,400)	57.56	(1,462.0)	+0.08	(+2.0)
				-0.06	(-1.5)
60	(1,500)	61.61	(1,564.9)	+0.08	(+2.0)
				-0.06	(-1.5)

*Closest customary metric equivalent.

NOTE: The external diameter of the pipe at the spigots shall be within the tolerances given in the table, and the manufacturer shall declare the allowable maximum and minimum spigot diameters. Some pipes are manufactured such that the entire pipe meets the OD tolerances, while other pipes meet the tolerances at the spigots—in which case, if such pipes are cut (shortened), the ends may need to be calibrated to meet the tolerances.

Table 5 Metric dimensions for outside diameter (OD) series pipe*

Nominal Size	Closest US Customary Size	External Pipe Diameter	US Equivalent [†]	Tolerance	
				Upper Limit	Lower Limit
DN <i>mm</i>	<i>in.</i>	<i>mm</i>	OD <i>in.</i>	<i>mm</i>	<i>mm</i>
300	12	310	12.20	+1.0	-1.0
350	14	361	14.21	+1.0	-1.2
400	16	412	16.22	+1.0	-1.4
450	18	463	18.23	+1.0	-1.6
500	20	514	20.24	+1.0	-1.8
600	24	616	24.25	+1.0	-2.0
700	27	718	28.27	+1.0	-2.2
800	30	820	32.28	+1.0	-2.4
900	36	924	36.38	+1.0	-2.6
1,000	39	1,026	40.69	+2.0	-2.6
1,200	48	1,229	48.39	+2.0	-2.6
1,400	54	1,434	56.46	+2.0	-2.8
1,600	63	1,638	64.49	+2.0	-2.8
1,800	72	1,842	72.52	+2.0	-3.0
2,000	78	2,046	80.55	+2.0	-3.0
2,200	84	2,250	88.58	+2.0	-3.2
2,400	96	2,453	96.57	+2.0	-3.4
2,600	102	2,658	104.65	+2.0	-3.6
2,800	108	2,861	112.64	+2.0	-3.8
3,000	120	3,066	120.71	+2.0	-4.0
3,200	126	3,270	128.74	+2.0	-4.2
3,400	132	3,474	136.77	+2.0	-4.4
3,600	144	3,678	144.80	+2.0	-4.6
3,800	150	3,882	152.83	+2.0	-4.8
4,000	156	4,086	160.87	+2.0	-5.0

*Values taken from international practice.

†US customary unit equivalent OD obtained by dividing millimeters by 25.4.

NOTE: The external diameter of the pipe at the spigots shall be within the tolerances given in the table, and the manufacturer shall declare the allowable maximum and minimum spigot diameters. Some pipes are manufactured such that the entire pipe meets the OD tolerances, while other pipes meet the tolerances at the spigots—in which case, if such pipes are cut (shortened), the ends may need to be calibrated to meet the tolerances.

Table 6 Metric dimensions for outside diameter (OD) series pipe with ductile-iron pipe equivalent ODs*

Nominal Size	Closest US Customary Size	External Diameter	US Equivalent [†]	Tolerance (<i>mm</i>)	
				Upper Limit	Lower Limit
DN <i>mm</i>	<i>in.</i>	<i>mm</i>	OD <i>in.</i>		
100	4	115.0	4.53	+1.0	+0.3
125	5	141.0	5.55	+1.0	+0.2
150	6	167.0	6.57	+1.0	+0.1
200	8	220.0	8.66	+1.0	-0.0
250	10	271.8	10.70	+1.0	-0.2
300	12	323.8	12.75	+1.0	-0.3
350	14	375.7	14.79	+1.0	-0.3
400	16	426.6	16.80	+1.0	-0.3
450	18	477.6	18.80	+1.0	-0.4
500	20	529.5	20.85	+1.0	-0.4
600	24	632.5	24.90	+1.0	-0.5

*Values taken from international practice.

†US customary unit equivalent OD obtained by dividing millimeters by 25.4.

NOTE: The external diameter of the pipe at the spigots shall be within the tolerances given in the table, and the manufacturer shall declare the allowable maximum and minimum spigot diameters. Some pipes are manufactured such that the entire pipe meets the OD tolerances, while other pipes meet the tolerances at the spigots—in which case, if such pipes are cut (shortened), the ends may need to be calibrated to meet the tolerances.

NOTE: Common practice in the industry provides for laying lengths of 10, 20, 30, 40, or 60 ft (3, 6, 9, 12, and 18 m).

4.5.3 *Wall thickness.* The average wall thickness of the pipe shall not be less than the nominal wall thickness published in the manufacturer's literature current at the time of purchase, and the minimum wall thickness at any point shall not be less than 87.5 percent of that nominal wall thickness when measured in accordance with ASTM D3567.

Sec. 4.6 Pressure Classes

The standard pressure classes for pipe shall be 50, 100, 150, 200, 250, 300, 350, 400, and 450 psig (345, 689, 1,034, 1,379, 1,724, 2,069, 2,414, 2,759, and 3,103 kPa). The pressure classes refer to the maximum sustained working pressure. They are determined in accordance with Sec. 4.6.2 using a design factor of 1.8. The pressure classes may have to be changed for pipes conveying water at

elevated temperatures (in accordance with the manufacturer's recommendations) and whenever there is a need to provide more allowance for surge pressure.

For pipe subjected to circumferential bending, the effect of this bending on the hydrostatic design pressure class of the pipe must be considered.

4.6.1 *Thermoplastic lined pipe.* The pressure classes for thermoplastic lined pipe are based on a water temperature of 73.4°F (23°C). The classes may need to be reduced for use at temperatures greater than 73.4°F (23°C). The temperature-degrading service factors shall be supplied by the pipe manufacturer.

4.6.2 *Long-term hydrostatic-design pressure.* The pressure classes shall be based on long-term hydrostatic-design pressure data extrapolated to 50 years, using procedure B of ASTM D2992 or, alternately, with the procedure specified in Annex A.1 of ASTM D3517. Procedure A data from ASTM D2992 may be used in place of procedure B data. End fixtures used during testing shall be representative of the product use as follows:

Service	Test End Fixture
Restrained joints	Free ends
Unrestrained joints	Fixed ends

Sec. 4.7 Stiffness Classes

The standard stiffness classes shall be 9, 18, 36, and 72 psi (62, 124, 248, and 496 kPa) and shall be determined in accordance with Sec. 5.1.2.2.

Sec. 4.8 Long-Term Ring-Bending Strain

4.8.1 *Long-term ring-bending strain, S_b .* Long-term ring-bending strain can be determined with creep-failure tests instrumented to detect an abrupt, significant reduction in mechanical properties. The test data should be statistically extrapolated to establish strength at 50 years. The value for S_b may be determined by testing per ASTM D5365, using a water test solution with a pH between 5 and 9. If these test results are not available, the value for S_b may be taken as the results of either of the following testing methods:

1. In accordance with ASTM D3681, using 1N H₂SO₄.
2. Using results of ASTM D2992, procedure B, extrapolated to 50 years.

Sec. 4.9 Joint Types and Requirements

The pipe shall have a joining system that shall not leak for the intended service condition. A particular type of joint may be restrained or unrestrained and flexible or rigid depending on the specific joint configuration and design conditions.

4.9.1 *Unrestrained.* Pipe joints capable of withstanding internal pressure but not longitudinal tensile loads.

4.9.1.1 Coupling or bell-and-spigot joints. Joints with a groove either on the spigot or in the bell to retain an elastomeric gasket that shall be the sole element of the joint to provide watertightness.

4.9.1.2 Mechanical couplings joint with elastomeric seals.

4.9.1.3 Butt joint with laminated overlay.

4.9.1.4 Flanged joint. Both integral and loose ring.

4.9.2 *Restrained.* Pipe joints capable of withstanding internal pressure and longitudinal tensile loads.

4.9.2.1 Joints similar to the joints in Sec. 4.9.1.1 but with supplemental restraining elements.

4.9.2.2 Butt joint with laminated overlay.

4.9.2.3 Bell-and-spigot joint with laminated overlay.

4.9.2.4 Bell-and-spigot adhesive bonded joint: Three types of adhesive-bonded joints are permitted by this standard. The permissible adhesive-bonded joints are as follows:

1. Tapered bell and spigot: An adhesive joint that is manufactured with a tapered socket for use in conjunction with a tapered spigot section and a suitable adhesive.

2. Straight bell and spigot: An adhesive joint that is manufactured with an untapered socket for use in conjunction with an untapered spigot and a suitable adhesive.

3. Tapered bell and straight spigot: An adhesive joint that is manufactured with a tapered socket for use in conjunction with an untapered spigot and a suitable adhesive.

4.9.2.5 Flanged. Both integral and loose ring.

4.9.2.6 Mechanical. An elastomeric sealed coupling with supplemental restraining elements.

4.9.3 *Performance requirements.*

4.9.3.1 Joint tightness. All joints shall meet the Laboratory Performance Requirements of Section 7 of ASTM D4161. Unrestrained joints shall be tested with a fixed-end closure condition and restrained joints shall be tested with a free-end closure condition. Rigid joints shall be exempt from angular deflection requirements of ASTM D4161. Rigid joints typically include butt joints with laminated overlay, flanged, and bell-and-spigot adhesive bonded.

4.9.3.2 Gaskets. Elastomeric gaskets shall conform to the requirements of ASTM F477.

NOTE: Restrained joints may increase service loads on the pipe to be greater than those experienced with unrestrained joints. The purchaser is cautioned to consider all conditions that may be encountered in the anticipated service and to consult with the manufacturer regarding the suitability of a particular type and class of pipe for service with restrained joint systems.

SECTION 5: VERIFICATION

Sec. 5.1 Inspection and Testing

5.1.1 *Plant inspection by purchaser.* Plant inspection by the purchaser or the omission of this inspection shall not relieve the manufacturer of the responsibility to provide products that comply with the applicable requirements of this standard and of the purchaser.

5.1.1.1 Production notice. When plant inspection is specified by the purchaser, the manufacturer shall provide the purchaser with adequate advance notice of when and where the production of ordered products will commence.

5.1.1.2 Inspection limitations. If a manufacturer desires to exclude inspection of proprietary manufacturing processes, the manufacturer shall so advise the purchaser.

5.1.1.3 Plant access. The purchaser's agent shall have free access to those parts of a manufacturer's plant that are necessary to ensure products comply with all requirements of this standard and of the purchaser. Access may be limited to areas of the manufacturer's plant not specifically excluded by the terms of Sec. 5.1.1.2.

5.1.1.4 Inspection aids. The manufacturer shall make available to the purchaser's agent, without charge, the tools and assistance necessary for inspection and handling of materials.

5.1.2 *Quality control tests and records.* The manufacturer shall take adequate measures in the production of products to ensure compliance with the requirements of this standard. To ensure compliance, the following tests shall be performed at the indicated intervals, unless otherwise specified by the purchaser. A manufacturing run shall be defined in the manufacturer's quality plan with a maximum six months' production interruption. The manufacturer shall maintain

a record of all quality control tests for a period of not less than two years and, if requested, shall submit the data to the purchaser.

5.1.2.1 Hydrostatic leak tests. Unless otherwise agreed on by the purchaser and supplier, the manufacturer shall perform hydrostatic leak tests to all pipe sizes 1 in. through 96 in. (25 mm through 2,400 mm). For sizes greater than 96 in. (2,400 mm), the frequency of hydrostatic leak tests shall be as agreed on by the manufacturer and purchaser. The pipe shall not fail, leak, or weep when tested at ambient temperatures according to Sec. 5.1.2.1.1.

5.1.2.1.1 A length of pipe, when tested, shall be placed in a hydrostatic-pressure test machine that seals the ends of the pipe. The pipe shall be filled with water, expelling all air, and an internal water pressure shall be applied at a uniform rate until a pressure of two (for pipe diameters up to and including 54 in.) and one and a half (for pipe diameters greater than 54 in. up to and including 96 in.) times the pressure class is reached (see Table 7). This test pressure shall be maintained for at least 30 sec. Further pumping of water to maintain the pressure is allowed during the 30-sec hold period. The pipe shall show no visual signs of weeping or leakage. Integral bells, including reinforcement sleeves, if any, or affixed couplings, shall be tested with the pipe.

5.1.2.2 Stiffness tests. The manufacturer shall perform stiffness tests at a frequency of one test for each 100 lengths of pipe produced or from each manufacturing run, whichever provides the most frequent sampling of each class and

Table 7 Hydrostatic leak test pressure requirements

Pressure Class		Hydrostatic Test Pressure			
		Pipe Diameters up to and Including 54 in.		Pipe Diameters Greater Than 54 in. up to and Including 96 in.	
<i>psi</i>	<i>kPa</i>	<i>psi</i>	<i>kPa</i>	<i>psi</i>	<i>kPa</i>
50	345	100	689	75	
100	689	200	1,379	150	1,034
150	1,034	300	2,068	225	1,551
200	1,379	400	2,758	300	2,069
250	1,724	500	3,447	375	2,586
300	2,069	600	4,138	450	3,103
350	2,414	700	4,828	525	3,620
400	2,750	800	5,518	600	4,137
450	3,103	900	6,206	675	4,654

Table 8 Minimum pipe stiffness requirements for 5 percent deflection

Nominal Pipe Size		Stiffness Class— <i>psi (kPa)</i>			
		9 (62)	18 (124)	36 (248)	72 (496)
<i>in.</i>	<i>(mm)</i>	Minimum Pipe Stiffness Required— <i>psi (kPa)</i>			
1–8	(25–200)	NR*	NR	36.0 (248)	72.0 (496)
10	(250)	NR	18.0 (124)	36.0 (248)	72.0 (496)
12–144	(300–3,600)	9.0 (62)	18.0 (124)	36.0 (248)	72.0 (496)

*Not recommended.

Table 9 Ring deflection without damage or structural failure

Deflection Level	Stiffness Class— <i>psi (kPa)</i>			
	9 (62)	18 (124)	36 (248)	72 (496)
	Ring Deflection—% of Diameter			
A	18	15	12	9
B	30	25	20	15

NOTE: For other stiffness classes, ring deflection, expressed as a percentage of pipe diameter, is calculated as follows:

$$\text{Level B} = 30(9/\text{pipe stiffness})^{0.33}$$

$$\text{Level A} = 0.6 (\text{Level B})$$

size. The minimum pipe stiffness ($F/\Delta Y$) shall be determined at 5 percent deflection using the apparatus and procedure of ASTM D2412, with three exceptions. The exceptions are (1) the wall thickness shall be measured to the nearest 0.01 in. (0.25 mm); (2) the specimen taken from the pipe barrel shall be loaded to 5 percent deflection, the load shall be recorded, and the loading continued to level A deflection (Table 9) and then to level B deflection; and (3) test frequency shall be as specified in this paragraph.

5.1.2.2.1 The pipe shall exhibit, without structural damage, the minimum stiffness specified in Table 8 when tested in accordance with Sec. 5.1.2.2.

5.1.2.2.2 At deflection level A (Table 9), there shall be no interior surface cracks or crazes. At deflection level B (Table 9), there shall be no structural damage as evidenced by interlaminar separation, separation of the liner or surface layer (if incorporated) from the structural wall, tensile failure of the glass-fiber reinforcement, and fracture or buckling of the pipe wall. Both level A and level B criteria must be met. The pipe stiffness test specimen may be used for these tests.

NOTE: This is a visual observation for quality control purposes only and should not be considered a simulated service test. Table 9 values are based on an in-use, long-term deflection limit of 5 percent and provide an appropriate uniform safety margin for all pipe stiffnesses.

1. For other pipe stiffness levels, appropriate values for level A and level B deflections (Table 9) may be computed as follows:

$$\text{Level A at new pipe stiffness (PS)} = 9 \times (72/\text{new PS})^{0.33}$$

$$\text{Level B at new pipe stiffness (PS)} = \text{new Level A} / 0.6$$

2. Because products may have limits of other than 5 percent long-term deflection, level A and level B deflections (Table 9) may be proportionally adjusted to maintain equivalent in-use safety margins. For example, a 4 percent long-term limiting deflection would result in a 20 percent reduction of level A and level B deflections, while a 6 percent limiting deflection would result in a 20 percent increase in level A and level B deflection values.

5.1.2.3 Hoop tensile strength tests. The manufacturer shall perform hoop tensile strength tests at a frequency of one test for each 100 lengths of pipe produced or from each manufacturing run, whichever provides the most frequent sampling of each class and size. The minimum hoop tensile strength properties shall be determined from the average of the test results of three specimens cut from the sample when using the apparatus and procedure of one of the following test methods:

1. ASTM D2290, procedure A. The specimen width shall be appropriate to the diameter and wall thickness of the pipe. Reduced-section specimens are acceptable. A test apparatus with a varying rate of motion may be used, provided that the speed of testing does not exceed 0.10 in./min (2.5 mm/min) in accordance with procedure A. Except in cases of disagreement, routine quality control tests may be performed at ambient conditions of temperature and humidity, and calculations need not include the standard deviation.

2. ASTM D638. The widths of specimens may be increased for pipe wall thicknesses greater than 0.55 in. (14 mm). Means may be provided to minimize the bending moment imposed during the test. Except in cases of disagreement, calculations from routine quality control test results need not include the standard deviation.

3. ASTM D1599.

5.1.2.3.1 The pipe shall meet or exceed the minimum short-term hoop tensile strength calculated by Eq 1 or Eq 2, whichever is greater. The minimum short-term hoop tensile strengths calculated per Eq 2 are stated in Table 10.A and 10.B.

$$F = S_i / S_r (P_r) \quad (\text{Eq 1})$$

$$F = 4.0 (P_r) \quad (\text{Eq 2})$$

Where:

F = required minimum hoop tensile strength, lbf/in. (kN/m) of width

S_i = initial design hoop tensile strength, psi (kPa)

S_r = hoop tensile stress at pressure class, psi (kPa)

P = specified pressure class from Table 7, psi (kPa)

r = nominal pipe radius, in. [(OD—single wall thickness)/2] (m)

5.1.2.3.2 The values of S_i and S_r should be established from the manufacturer's long-term hydrostatic tests performed in accordance with Sec. 4.6.2. S_i shall be taken as the 95 percent lower-confidence level, back extrapolated to 0.1 hr. This takes into consideration variations in glass-fiber strength and manufacturing methods. S_r is the calculated hoop tensile stress at the pressure class.

5.1.2.4 Axial tensile strength tests. The manufacturer shall perform axial tensile strength tests at a frequency of one test for each 100 lengths of pipe produced or from each manufacturing run, whichever provides the most frequent sampling of each class and size. The minimum axial tensile strength shall be determined from the average of the test results of three specimens cut from the sample when using the apparatus and procedure of ASTM D638, except the provisions for maximum thickness shall not apply; or ASTM D2105, depending on the size of the pipe specimens to be tested.

5.1.2.4.1 The pipe shall have a minimum axial tensile elongation to failure of 0.25 percent and meet or exceed the minimum axial tensile strength requirements listed in Table 11 when tested in accordance with ASTM D638 or ASTM D2105.

NOTE: The values in Table 11 are the minimum criteria and are based on buried pipe without axial thrust loads. Required axial strength for aboveground pipes subject to beam bending, or any pipes that must withstand longitudinal thrust loads or any unusual axial tensile forces, may exceed the values in Table 11.A and 11.B.

5.1.2.5 Beam-strength tests. The beam-strength test is a design-qualification test required only when there is a significant change in the design or construction of the pipe. A significant change is considered to occur when the average axial

Table 10.A Minimum hoop strength requirements (from Eq 2) (lbf/in. of width)

Nominal Diameter (in.)	Pressure Class								
	50 (psi)	100 (psi)	150 (psi)	200 (psi)	250 (psi)	300 (psi)	350 (psi)	400 (psi)	450 (psi)
1.0	100	200	300	400	500	600	700	800	900
1.5	150	300	450	600	750	900	1,050	1,200	1,350
2.0	200	400	600	800	1,000	1,200	1,400	1,600	1,800
2.5	250	500	750	1,000	1,250	1,500	1,750	2,000	2,250
3.0	300	600	900	1,200	1,500	1,800	2,100	2,400	2,700
4.0	400	800	1,200	1,600	2,000	2,400	2,800	3,200	3,600
6.0	600	1,200	1,800	2,400	3,000	3,600	4,200	4,800	5,400
8.0	800	1,600	2,400	3,200	4,000	4,800	5,600	6,400	7,200
10.0	1,000	2,000	3,000	4,000	5,000	6,000	7,000	8,000	9,000
12.0	1,200	2,400	3,600	4,800	6,000	7,200	8,400	9,600	10,800
14.0	1,400	2,800	4,200	5,600	7,000	8,400	9,800	11,200	12,600
15.0	1,500	3,000	4,500	6,000	7,500	9,000	10,500	12,000	13,500
16.0	1,600	3,200	4,800	6,400	8,000	9,600	11,200	12,800	14,400
18.0	1,800	3,600	5,400	7,200	9,000	10,800	12,600	14,400	16,200
20.0	2,000	4,000	6,000	8,000	10,000	12,000	14,000	16,000	18,000
21.0	2,100	4,200	6,300	8,400	10,500	12,600	14,700	16,800	18,900
24.0	2,400	4,800	7,200	9,600	12,000	14,400	16,800	19,200	21,600
27.0	2,700	5,400	8,100	10,800	13,500	16,200	18,900	21,600	24,300
30.0	3,000	6,000	9,000	12,000	15,000	18,000	21,000	24,000	27,000
33.0	3,300	6,600	9,900	13,200	16,500	19,800	23,100	26,400	29,700
36.0	3,600	7,200	10,800	14,400	18,000	21,600	25,200	28,800	32,400
39.0	3,900	7,800	11,700	15,600	19,500	23,400	27,300	31,200	35,100
42.0	4,200	8,400	12,600	16,800	21,000	25,200	29,400	33,600	37,800
45.0	4,500	9,000	13,500	18,000	22,500	27,000	31,500	36,000	40,500
48.0	4,800	9,600	14,400	19,200	24,000	28,800	33,600	38,400	43,200
51.0	5,100	10,200	15,300	20,400	25,500	30,600	35,700	40,800	45,900
54.0	5,400	10,800	16,200	21,600	27,000	32,400	37,800	43,200	48,600
60.0	6,000	12,000	18,000	24,000	30,000	36,000	42,000	48,000	54,000
66.0	6,600	13,200	19,800	26,400	33,000	39,600	46,200	52,800	59,400
72.0	7,200	14,400	21,600	28,800	36,000	43,200	50,400	57,600	64,800
78.0	7,800	15,600	23,400	31,200	39,000	46,800	54,600	62,400	70,200
84.0	8,400	16,800	25,200	33,600	42,000	50,400	58,800	67,200	75,600
90.0	9,000	18,000	27,000	36,000	45,000	54,000	63,000	72,000	81,000
96.0	9,600	19,200	28,800	38,400	48,000	57,600	67,200	76,800	86,400
102.0	10,200	20,400	30,600	40,800	51,000	61,200	71,400	81,600	91,800
108.0	10,800	21,600	32,400	43,200	54,000	64,800	75,600	86,400	97,200
114.0	11,400	22,800	34,200	45,600	57,000	68,400	79,800	91,200	102,600
120.0	12,000	24,000	36,000	48,000	60,000	72,000	84,000	96,000	108,000
132.0	13,200	26,400	39,600	52,800	66,000	79,200	92,400	105,600	118,800
144.0	14,400	28,800	43,200	57,600	72,000	86,400	100,800	115,200	129,600
156.0	15,600	31,200	46,800	62,400	78,000	93,600	109,200	124,800	140,400

Table 10.B Minimum hoop tensile strength requirements (from Eq 2) (N/mm of width)

Nominal Diameter (mm)	Pressure Class kPa								
	245 (kPa)	689 (kPa)	1,034 (kPa)	1,379 (kPa)	1,724 (kPa)	2,069 (kPa)	2,414 (kPa)	2,759 (kPa)	3,103 (kPa)
25	17	34	52	69	86	103	121	138	155
40	28	55	83	110	138	166	193	221	248
50	35	69	103	138	172	207	241	276	310
65	45	90	134	179	224	269	314	359	403
80	55	110	165	221	276	331	386	441	496
100	69	138	207	276	345	414	483	552	621
150	104	207	310	414	517	621	724	828	931
200	138	276	414	552	690	828	966	1,104	1,241
250	173	345	517	690	862	1,035	1,207	1,380	1,552
300	207	413	620	827	1,034	1,241	1,448	1,655	1,862
350	242	482	724	965	1,207	1,448	1,690	1,931	2,172
375	259	517	776	1,034	1,293	1,552	1,811	2,069	2,327
400	276	551	827	1,103	1,379	1,655	1,931	2,207	2,482
450	311	620	931	1,241	1,552	1,862	2,173	2,483	2,793
500	345	689	1,034	1,379	1,724	2,069	2,414	2,759	3,103
550	380	758	1,137	1,517	1,896	2,276	2,655	3,035	3,413
600	414	827	1,241	1,655	2,069	2,483	2,897	3,311	3,724
700	483	965	1,448	1,931	2,414	2,897	3,380	3,863	4,344
750	518	1,034	1,551	2,069	2,586	3,104	3,621	4,139	4,655
850	587	1,171	1,758	2,344	2,931	3,517	4,104	4,690	5,275
900	621	1,240	1,861	2,482	3,103	3,724	4,345	4,966	5,585
1,000	690	1,378	2,068	2,758	3,448	4,138	4,828	5,518	6,206
1,100	759	1,516	2,275	3,034	3,793	4,552	5,311	6,070	6,827
1,150	794	1,585	2,378	3,172	3,965	4,759	5,552	6,346	7,137
1,200	828	1,654	2,482	3,310	4,138	4,966	5,794	6,622	7,447
1,300	897	1,791	2,688	3,585	4,482	5,379	6,276	7,173	8,068
1,400	966	1,929	2,895	3,861	4,827	5,793	6,759	7,725	8,688
1,500	1,035	2,067	3,102	4,137	5,172	6,207	7,242	8,277	9,309
1,700	1,173	2,343	3,516	4,689	5,862	7,035	8,208	9,381	10,550
1,800	1,242	2,480	3,722	4,964	6,206	7,448	8,690	9,932	11,171
2,000	1,380	2,756	4,136	5,516	6,896	8,276	9,656	11,036	12,412
2,200	1,518	3,032	4,550	6,068	7,586	9,104	10,622	12,140	13,653
2,300	1,587	3,169	4,756	6,343	7,930	9,517	11,104	12,691	14,274
2,400	1,656	3,307	4,963	6,619	8,275	9,931	11,587	13,243	14,894
2,600	1,794	3,583	5,377	7,171	8,965	10,759	12,553	14,347	16,136
2,800	1,932	3,858	5,790	7,722	9,654	11,586	13,518	15,450	17,377
2,900	2,001	3,996	5,997	7,998	9,999	12,000	14,001	16,002	17,997
3,000	2,070	4,134	6,204	8,274	10,344	12,414	14,484	16,554	18,618
3,400	2,346	4,685	7,031	9,377	11,723	14,069	16,415	18,761	21,100
3,600	2,484	4,961	7,445	9,929	12,413	14,897	17,381	19,865	22,342
4,000	2,760	5,512	8,272	11,032	13,792	16,552	19,312	22,072	24,824

Table 11.A Minimum axial strength requirements (lbf /in. of circumference)

Nominal Diameter (in.)	Pressure Class								
	50 (psi)	100 (psi)	150 (psi)	200 (psi)	250 (psi)	300 (psi)	350 (psi)	400 (psi)	450 (psi)
1.0	360	360	360	360	360	360	360	360	360
1.5	360	360	360	360	360	360	360	360	360
2.0	360	360	360	360	360	360	360	360	360
2.5	360	360	360	360	360	360	360	360	360
3.0	360	360	360	360	360	360	360	360	360
4.0	360	360	360	360	360	360	364	400	450
6.0	360	360	360	360	405	468	525	600	675
8.0	580	580	580	580	580	624	700	800	900
10.0	580	580	580	580	650	780	875	1,000	1,125
12.0	580	580	580	624	780	936	1,050	1,200	1,350
14.0	580	580	609	728	910	1,092	1,225	1,400	1,575
15.0	580	580	653	780	975	1,170	1,313	1,500	1,688
16.0	580	580	696	832	1,040	1,248	1,400	1,600	1,800
18.0	580	580	783	936	1,170	1,404	1,575	1,800	2,025
20.0	580	580	870	1,040	1,300	1,560	1,750	2,000	2,250
21.0	580	609	914	1,092	1,365	1,638	1,838	2,100	2,363
24.0	580	696	1,044	1,248	1,560	1,800	2,100	2,400	2,700
27.0	580	783	1,175	1,404	1,688	2,025	2,363	2,700	3,038
30.0	580	870	1,305	1,560	1,875	2,250	2,625	3,000	3,375
33.0	627	957	1,436	1,716	2,063	2,475	2,888	3,300	3,713
36.0	684	1,044	1,566	1,800	2,250	2,700	3,150	3,600	4,050
39.0	741	1,131	1,697	1,872	2,340	2,808	3,276	3,744	4,212
42.0	798	1,218	1,827	2,016	2,520	3,024	3,528	4,032	4,536
45.0	855	1,305	1,958	2,160	2,700	3,240	3,780	4,320	4,860
48.0	912	1,392	2,088	2,304	2,880	3,456	4,032	4,608	5,184
51.0	969	1,479	2,219	2,448	3,060	3,672	4,284	4,896	5,508
54.0	1,026	1,566	2,349	2,592	3,240	3,726	4,347	4,968	5,589
60.0	1,140	1,740	2,520	2,880	3,600	4,140	4,830	5,520	6,210
66.0	1,254	1,914	2,673	3,036	3,795	4,554	5,313	5,808	6,534
72.0	1,368	2,088	2,916	3,312	4,140	4,968	5,796	6,336	7,128
78.0	1,482	2,106	3,159	3,432	4,290	5,148	6,006	6,864	7,722
84.0	1,596	2,268	3,402	3,696	4,620	5,292	6,174	7,056	7,938
90.0	1,710	2,430	3,645	3,960	4,950	5,670	6,615	7,380	8,303
96.0	1,824	2,592	3,888	4,224	5,280	6,048	7,056	7,680	8,640
102.0	1,938	2,754	4,131	4,488	5,610	6,426	7,497	8,160	9,180
108.0	2,052	2,916	4,374	4,752	5,940	6,804	7,938	8,640	9,720
114.0	2,166	3,078	4,617	5,016	6,270	7,182	8,379	9,120	10,260
120.0	2,280	3,240	4,860	5,280	6,600	7,560	8,820	9,600	10,800
132.0	2,508	3,564	5,346	5,808	7,260	8,316	9,702	10,560	11,880
144.0	2,736	3,888	5,832	6,336	7,920	9,072	10,584	11,520	12,960
156.0	2,964	4,212	6,318	6,864	8,580	9,828	11,466	12,480	14,040

Table 11.B Minimum axial strength requirements (N/mm of circumference)

Nominal Diameter (mm)	Pressure Class								
	345 (kPa)	689 (kPa)	1,034 (kPa)	1,379 (kPa)	1,724 (kPa)	2,069 (kPa)	2,414 (kPa)	2,759 (kPa)	3,103 (kPa)
25	63	63	63	63	63	63	63	63	63
40	63	63	63	63	63	63	63	63	63
50	63	63	63	63	63	63	63	63	63
65	63	63	63	63	63	63	63	63	63
80	63	63	63	63	63	63	63	63	63
100	63	63	63	63	63	63	64	70	79
150	63	63	63	63	71	82	92	105	118
200	102	102	102	102	102	109	123	140	158
250	102	102	102	102	114	137	153	175	197
300	102	102	102	109	137	164	184	210	236
350	102	102	107	127	159	191	215	245	276
375	102	102	114	137	171	205	230	263	296
400	102	102	122	146	182	219	245	280	315
450	102	102	137	164	205	246	276	315	355
500	102	102	152	182	228	273	306	350	394
550	102	107	160	191	239	287	322	368	414
600	102	122	183	219	273	315	368	420	473
700	102	137	206	246	296	355	414	473	532
750	102	152	229	273	328	394	460	525	591
850	110	168	251	301	361	433	506	578	650
900	120	183	274	315	394	473	552	630	709
1,000	130	198	297	328	410	492	574	656	738
1,100	140	213	320	353	441	530	618	706	794
1,150	150	229	343	378	473	567	662	757	851
1,200	160	244	366	403	504	605	706	807	908
1,300	170	259	388	429	536	643	750	857	965
1,400	180	274	411	454	567	652	761	870	979
1,500	200	305	441	504	630	725	846	967	1,087
1,700	220	335	468	532	665	797	930	1,017	1,144
1,800	240	366	511	580	725	870	1,015	1,110	1,248
2,000	260	369	553	601	751	902	1,052	1,202	1,352
2,200	279	397	596	647	809	927	1,081	1,236	1,390
2,300	299	426	638	693	867	993	1,158	1,292	1,454
2,400	319	454	681	740	925	1,059	1,236	1,345	1,513
2,600	339	482	723	786	982	1,125	1,313	1,429	1,608
2,800	359	511	766	832	1,040	1,192	1,390	1,513	1,702
2,900	379	539	809	878	1,098	1,258	1,467	1,597	1,797
3,000	399	567	851	925	1,156	1,324	1,545	1,681	1,891
3,400	439	624	936	1,017	1,271	1,456	1,699	1,849	2,080
3,600	479	681	1,021	1,110	1,387	1,589	1,853	2,017	2,270
4,000	519	738	1,106	1,202	1,503	1,721	2,008	2,185	2,459

Table 12 Beam strength requirements

Nominal Pipe Size		Beam Load P	
<i>in.</i>	<i>(mm)*</i>	<i>lbf</i>	<i>kN</i>
1	(25)	10	(0.04)
1½	(40)	25	(0.11)
2	(50)	45	(0.20)
2½	(65)	75	(0.33)
3	(80)	100	(0.44)
4	(100)	185	(0.82)
6	(150)	425	(1.90)
8	(200)	800	(3.60)
10	(250)	1,200	(5.30)
12	(300)	1,600	(7.10)
14	(350)	2,200	(9.80)
15	(375)	2,600	(11.60)
16	(400)	3,000	(13.30)
18	(450)	4,000	(17.80)
20	(500)	4,400	(19.60)
21	(550)	5,000	(22.20)
24	(600)	6,400	(28.50)
27	(700)	8,000	(35.60)

*Closest customary metric equivalent.

tensile strength as determined in Sec. 5.1.2.4 decreases more than 15 percent. Two methods can be used.

Method 1: Method 1 can be used for pipe sizes up to and including 27 in. (700 mm). In method 1, the pipe shall withstand, without failure, the beam loads listed in Table 12 when tested in accordance with the beam-strength test method of ASTM D3517.

Method 2: Method 2 can be used for all pipe sizes. In method 2, the pipe shall meet or exceed (1) the minimum axial tensile strength listed in Table 11 when tested in accordance with Sec. 5.1.2.4; and (2) the minimum axial compressive strength listed in Table 13 when tested in accordance with ASTM D695.

5.1.2.6 Dimensions. The manufacturer shall inspect one length per 100 lengths of pipe before shipment for dimensions and tolerances outlined in Sec. 4.5.

Table 13 Minimum axial compressive strength requirements

Nominal Pipe Size		Minimum Axial Compressive Strength	
<i>in.</i>	<i>(mm)*</i>	<i>lb/in. of circumference</i>	<i>(kN/m of circumference)</i>
1–6	(25–150)	360	(63)
8–30	(200–800)	580	(102)
33	(850)	640	(111)
36	(900)	700	(122)
39	(1,000)	780	(137)
42	(1,100)	800	(140)
45	(1,150)	860	(150)
48	(1,200)	920	(161)
51	(1,300)	980	(171)
54	(1,400)	1,040	(182)
60	(1,500)	1,140	(200)
66	(1,700)	1,260	(220)
72	(1,800)	1,360	(238)
78	(2,000)	1,480	(260)
84	(2,200)	1,600	(280)
90	(2,300)	1,720	(301)
96	(2,400)	1,840	(322)
102	(2,600)	1,940	(340)
108	(2,800)	2,060	(360)
114	(2,900)	2,180	(382)
120	(3,000)	2,280	(400)
132	(3,400)	2,520	(440)
144	(3,600)	2,740	(480)
156	(4,000)	2,964	(520)

*Closest customary metric equivalent

Sec. 5.2 Rejection and Retesting

If the results of a test do not conform to the requirements of this standard, that test may be repeated on two additional samples from the same lot of pipe. Each of the two samples shall conform to the requirements specified. If either of the two additional samples fail, the lot may be rejected, at the option of the purchaser. Rejection should be reported to the manufacturer or supplier promptly and in writing.

SECTION 6: DELIVERY

Sec. 6.1 Marking

Each standard length and random length shall be clearly marked. Marking shall be applied without indentation so as to remain legible during normal handling and installation practices. At a minimum, these markings shall consist of the following: (1) the phrase ANSI/AWWA C950; (2) nominal pipe size, cell classification, and diameter series; (3) AWWA pressure class; (4) stiffness class; and (5) manufacturer's mark and identity code.


Sec. 6.2 Shipping

All pipe and couplings shall, unless otherwise specified by the purchaser, be prepared for standard commercial shipment.


Sec. 6.3 Affidavit of Compliance


The manufacturer shall, if so specified by the purchaser, provide an affidavit that all delivered materials comply with the requirements of this standard and of the purchaser.

This page intentionally blank.

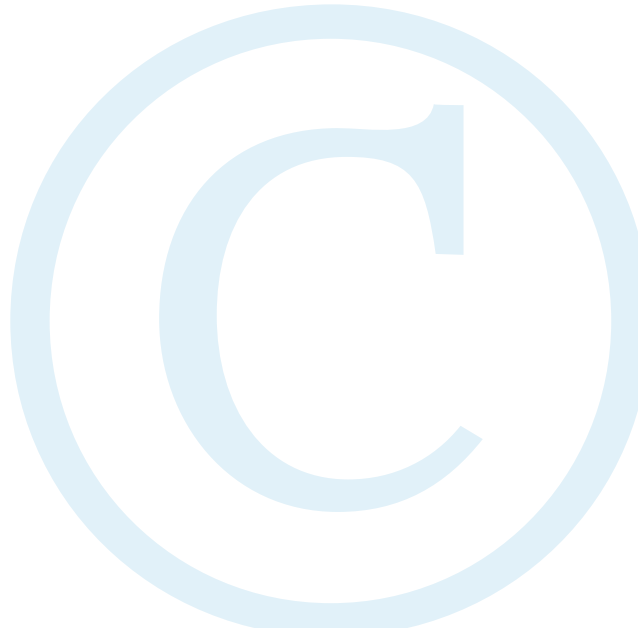

This page intentionally blank.

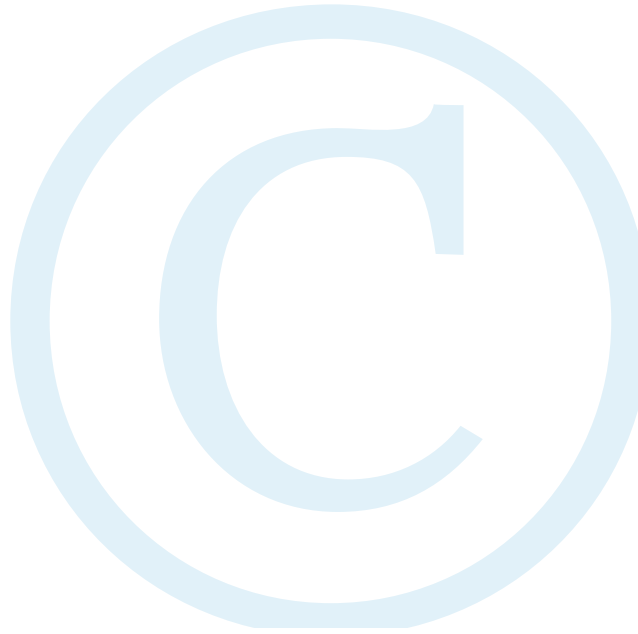

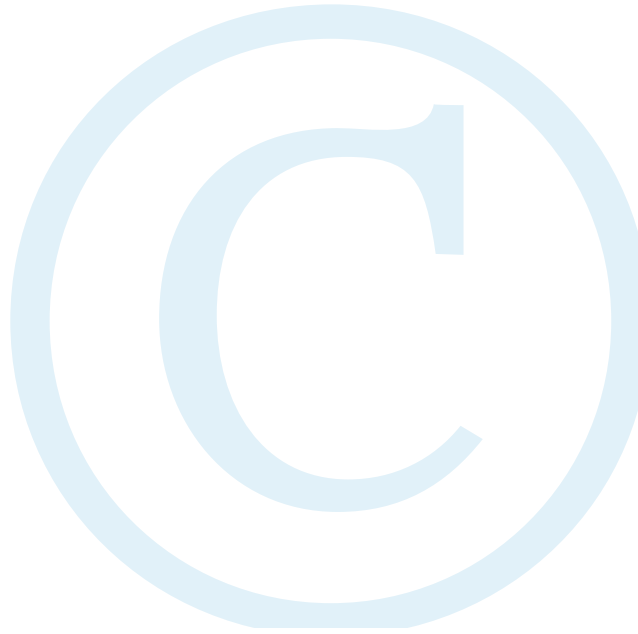

AWWA is the authoritative resource for knowledge, information, and advocacy to improve the quality and supply of water in North America and beyond. AWWA is the largest organization of water professionals in the world. AWWA advances public health, safety, and welfare by uniting the efforts of the full spectrum of the entire water community. Through our collective strength, we become better stewards of water for the greatest good of people and the environment.

1P-2.1M 43950 (3/13) FM



Printed on Recycled Paper

ISBN 9781583219164



9 781583 219164 >